


* WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. *

NOTES:

1. Weatherproof fittings required.
2. Wire sized to total disconnect size.
3. Neutral may only be reduced two sizes on residential application. No reduction of the neutral is allowed on commercial application.
4. Meter assembly must remain unenclosed on exterior of structure.
5. Meter assembly cannot be mounted on a mobile home.
6. All secondary connections made by Bluebonnet.

BUILDING OR RESIDENCE

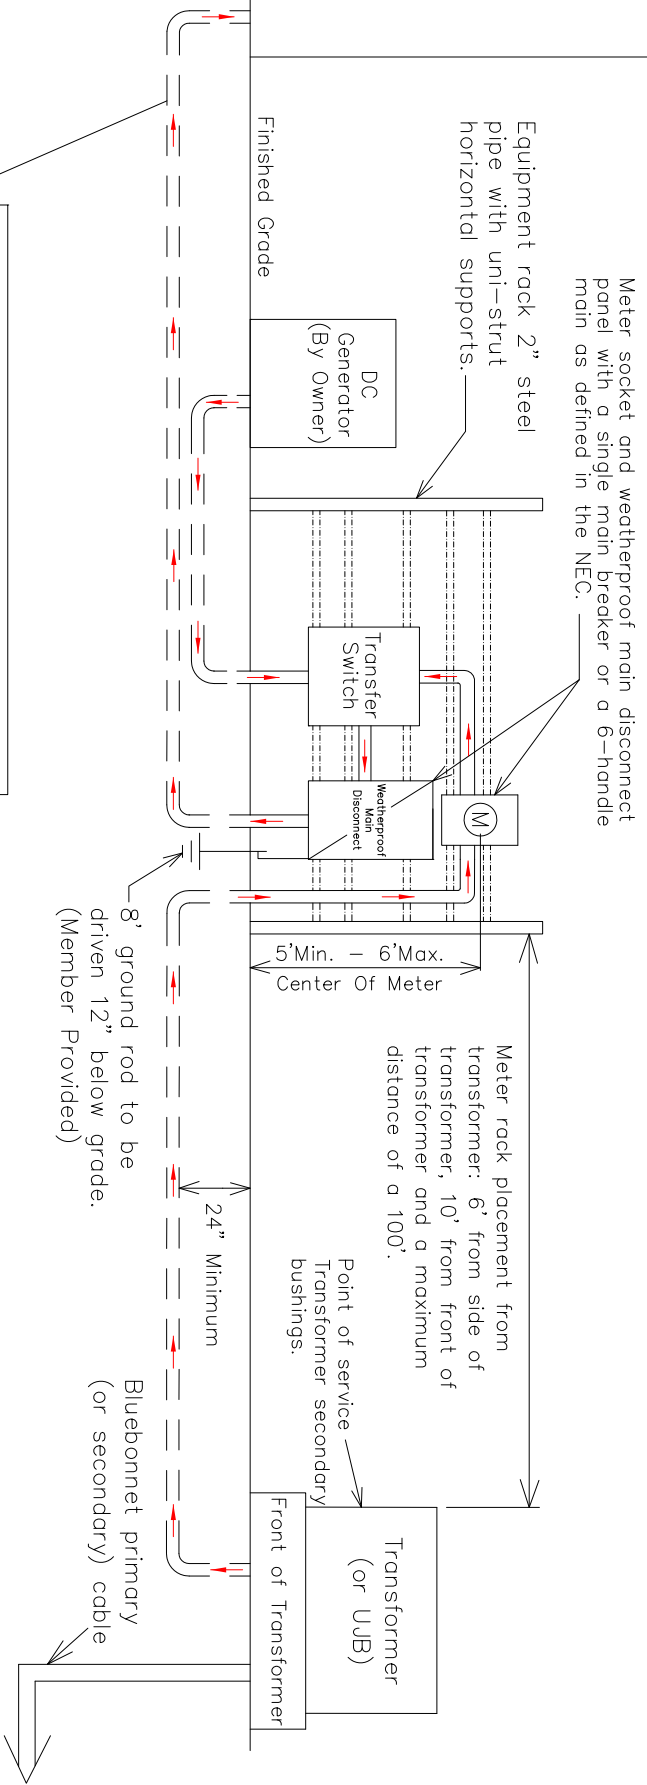

Minimum schedule 40 rigid nonmetallic service conduit below finished grade. No schedule 40 conduit allowed above ground level on source side of main disconnect.

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESC.

www.bluebonnetelectric.coop/myHome/electricServices/meterLoop.aspx

Latest update can be found at



60-400 AMP 1Ø URD SERVICE TO A UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON RACK OR BUILDING.		Drawn By :	Checked By :	Approved By :
DATE	REVISIONS	RG	MS COMMITTEE	TE
11-15-2016	ADDED FLOW ARROWS.	Scale :	Date :	MS-402
		NONE	11-15-2016	