


**NOTES:**

1. Weatherproof fittings required
2. Bluebonnet pole must remain free of structures and private attachments other than meter loop riser assembly.
3. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.
4. Generator shall be placed a minimum of 15' away from Bluebonnet's pole and/or equipment.



\* WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. \*

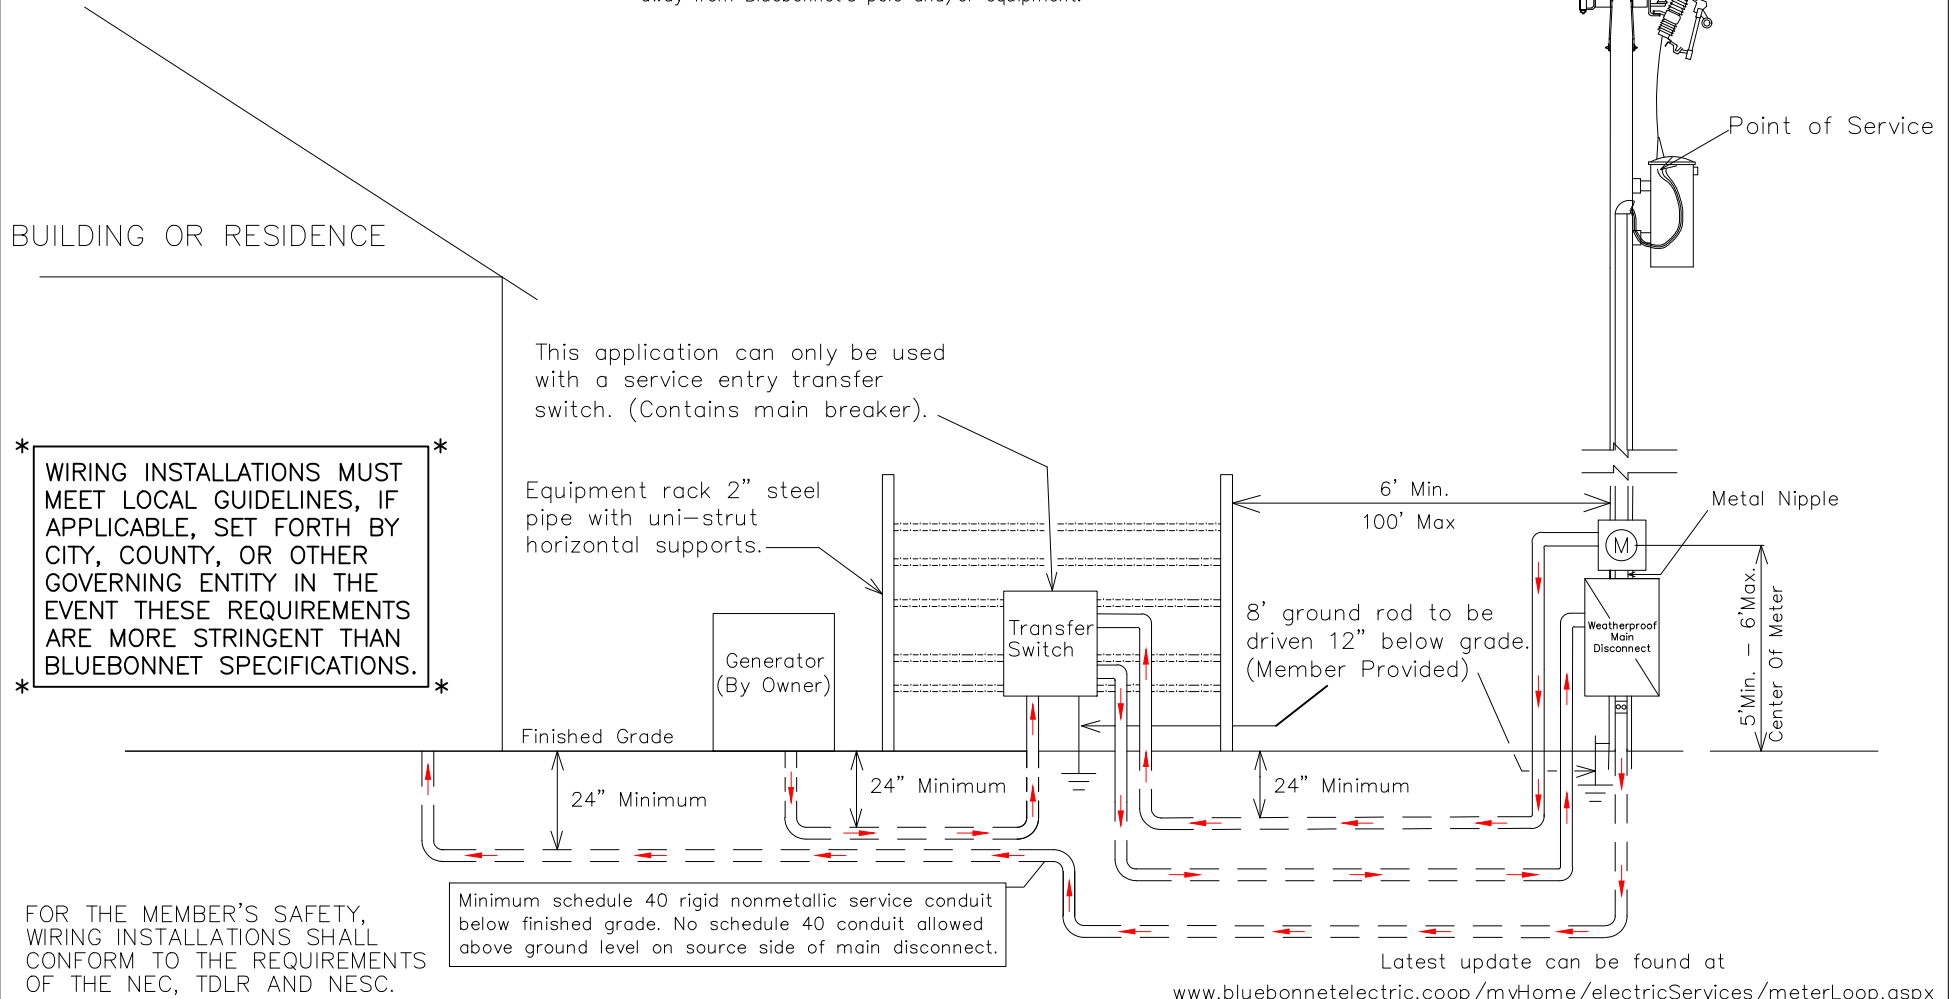

60-200 AMP 1Ø Existing O/H SERVICE WITH UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON RACK OR BUILDING.	
DATE	REVISIONS
11-15-2016	ADDED FLOW ARROWS.
03-29-2018	ADDED METAL NIPPLE
10-30-2018	ADDED GROUND TO RACK

Drawn By : JW	Checked By : MS COMMITTEE	Approved By : RG
Scale : NONE	Date : 03-29-2018	MS-407