



WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS.

- Notes:
- Covers on circuit breaker compartments must be removable without disturbing meters.
 - Meter socket components must be readily accessible and removable for maintenance.
 - Weatherproof fittings required.
 - Wire sized to total disconnect sizes.
 - Neutral(s) may be reduced no more than two sizes on residential application. No reduction of the neutral(s) is allowed on commercial application.
 - For all URD jobs, electricians should call in for locate before digging to Bluebonnet equipment.
 - Bluebonnet will complete wiring into transformer. Have sufficient amount of wire for termination. Meter loop must remain unenclosed on exterior of structure.
 - If a main disconnect module is used, its cover must have provisions for a standard Bluebonnet padlock.
 - All secondary connections made by Bluebonnet.
 - Member/Electrician shall coordinate with Bluebonnet personnel to install all conduit and the pulling of the secondary wire to the transformer. Member/Electrician shall notify Bluebonnet 48 hours in advance to schedule a time/date to perform the work. If additional trips are made to the site by Bluebonnet personnel, applicable fees maybe applied.
 - #6 Solid, Bare ground copper wire and clamp attached to Bluebonnet's pole ground.
 - No more than one disconnect per enclosure.


Pre-bussed meter modules
Single Phase installations are limited to an 800A main disconnect.

*Exception for 4 and 5 stack meter modules

Pre-bussed meter modules

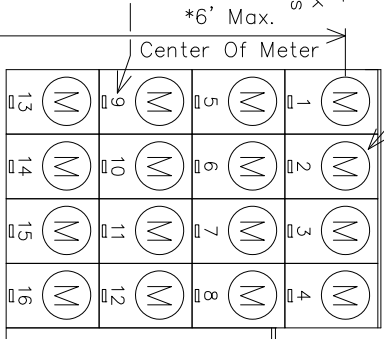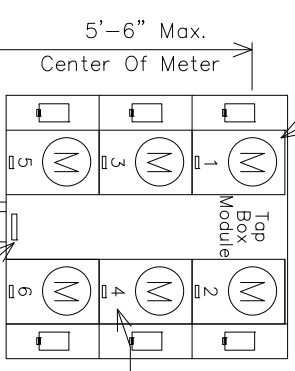

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESCC.

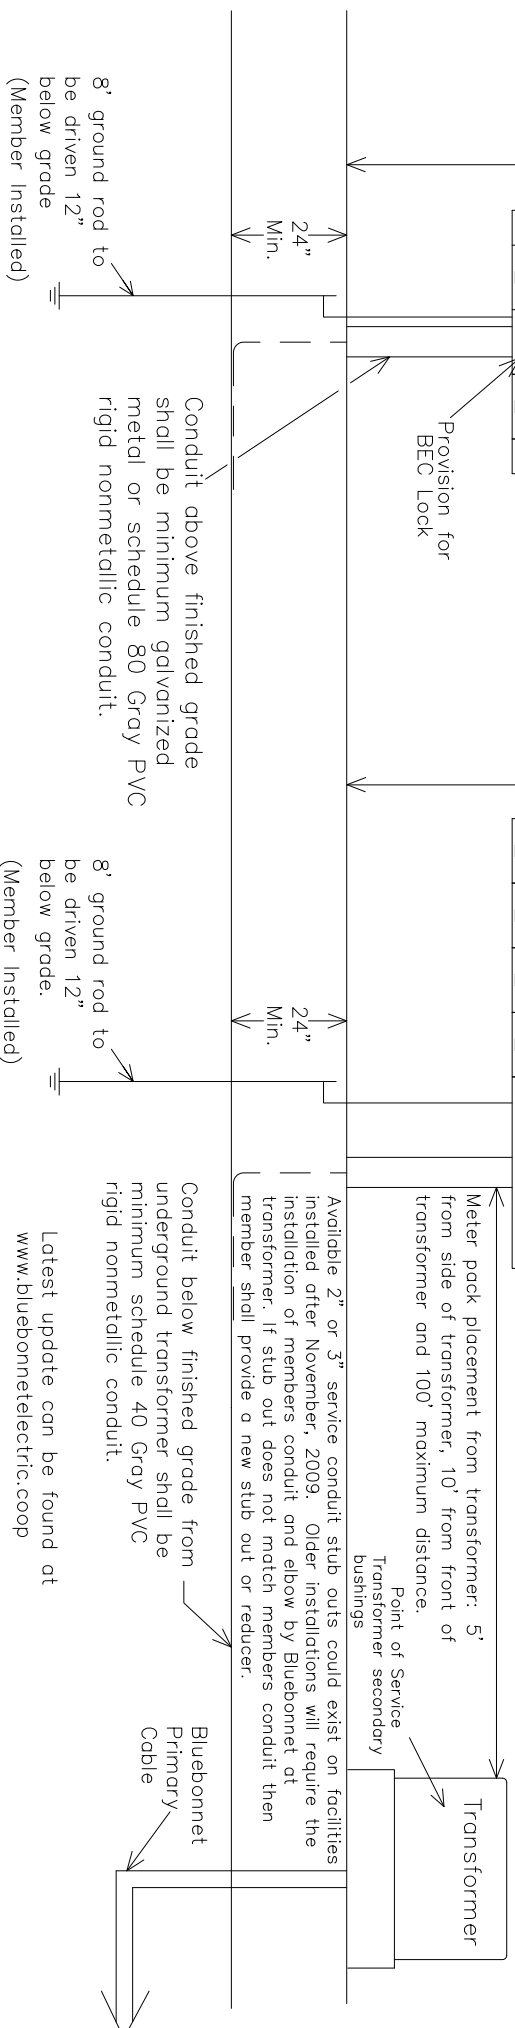

1 Ø 60-200 AMP UNDERGROUND MULTI-PACK METERS ON BUILDING		Drawn By :	BS	Checked By :	MS COMMITTEE	Approved By :	MS COMMITTEE
DATE	REVISIONS	Scale :	NONE	Date :	11-04-2021		
11-20-19	Added Solid Copper Note.						
11-04-21	Added Main Breaker Note.						