


- NOTES:
1. Weatherproof fittings required
 2. Bluebonnet pole must remain free of structures and private attachments
 3. Member's equipment shall not be attached to other than meter loop riser assembly.
 3. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.
 4. Generator shall be placed a minimum of 15' away from Bluebonnet's pole and/or equipment.
 5. #6 solid, bare ground copper wire and clamp attached to Bluebonnet's pole ground.

BUILDING OR RESIDENCE

* WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. *

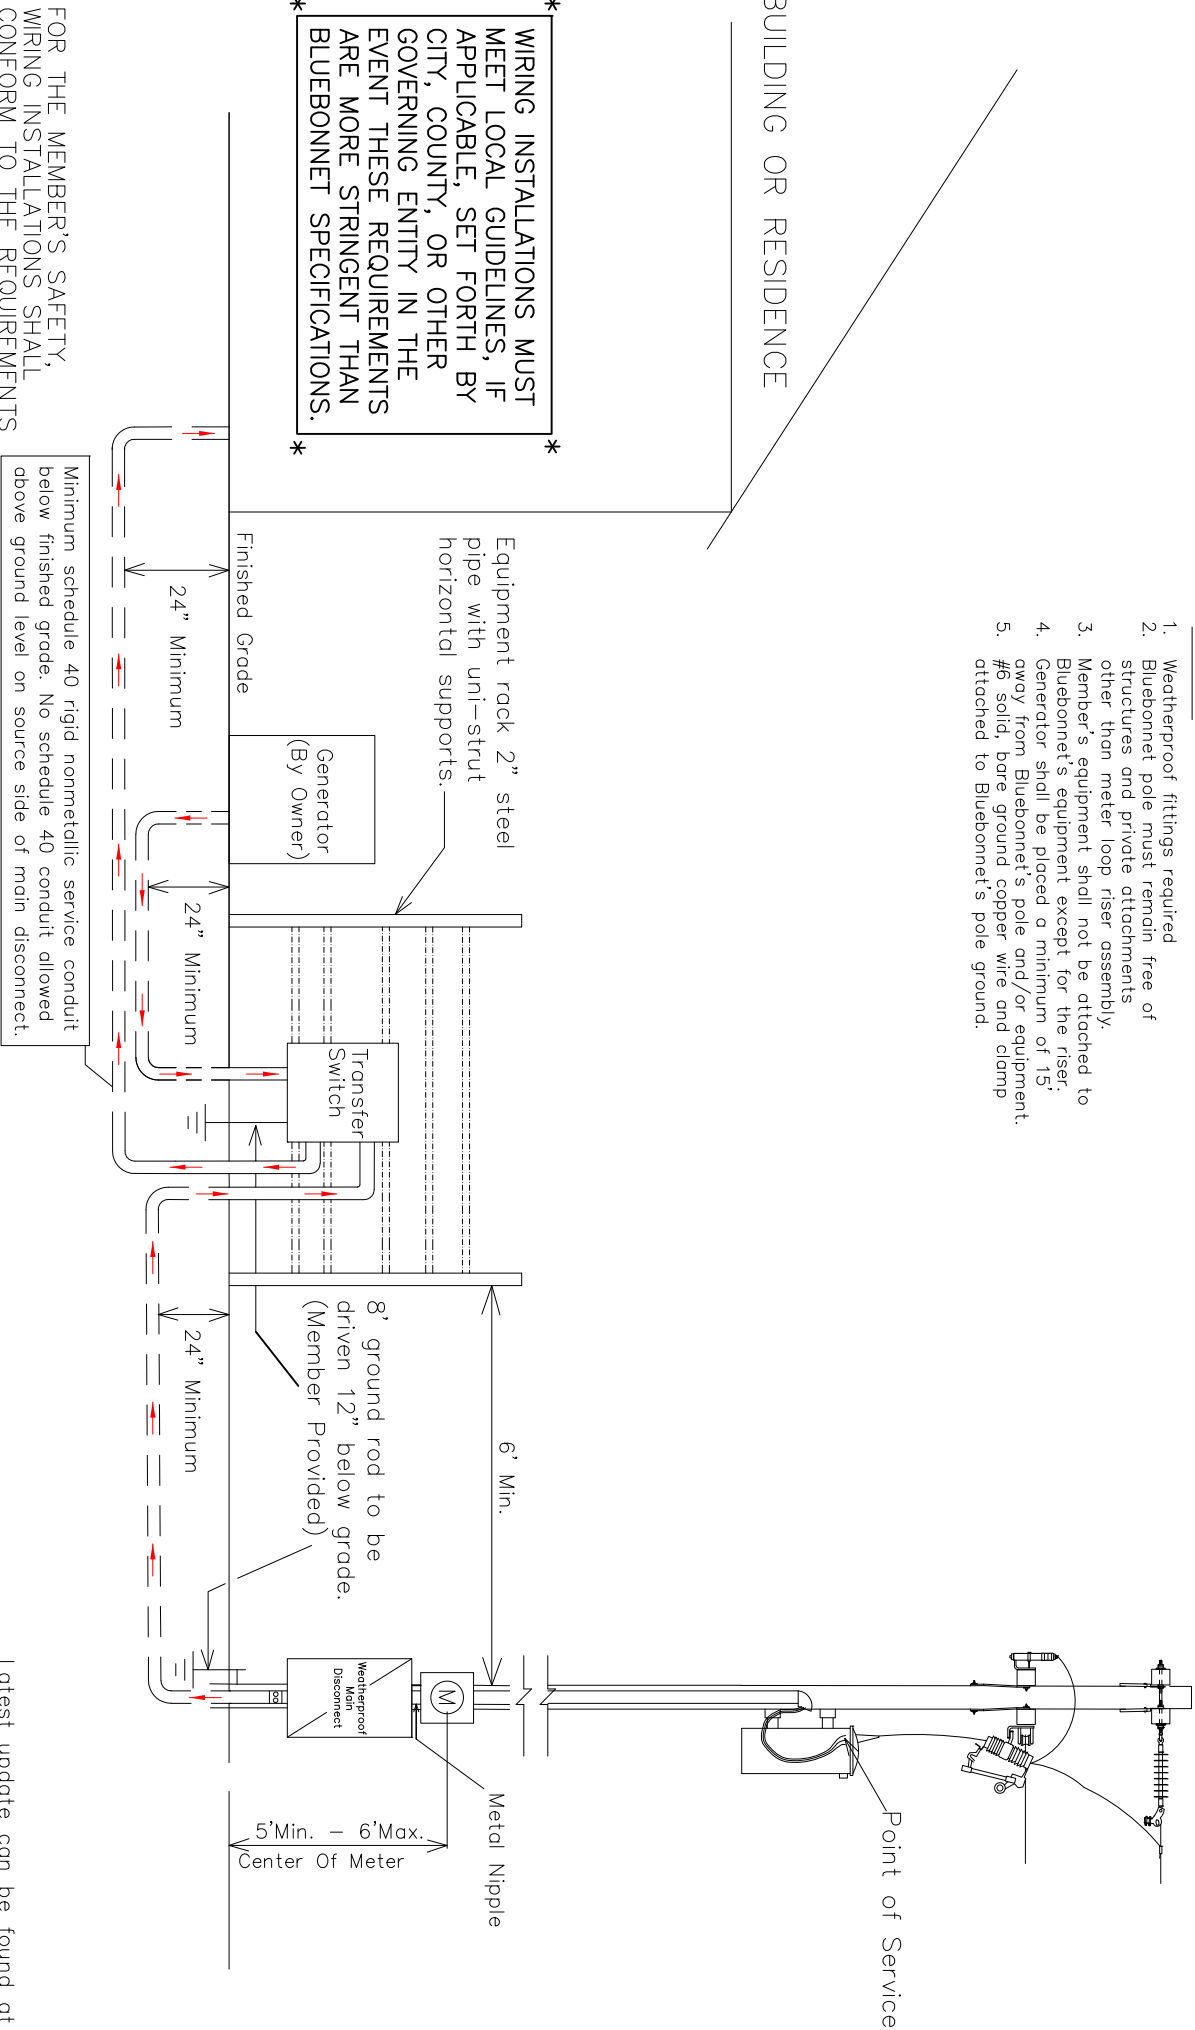

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESCS.

Latest update can be found at www.bluebonnetelectric.coop



60-200 AMP 1Ø O/H EXISTING SERVICE WITH UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON POLE.		Drawn By : SF	Checked By : MS COMMITTEE	Approved By : MS COMMITTEE
DATE	REVISIONS	Scale : NONE	Date : 02-03-2022	MS-400