


- NOTES:**
1. Weatherproof fittings required
  2. Bluebonnet pole must remain free of structures and private attachments other than meter loop riser assembly.
  3. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.
  4. Generator shall be placed a minimum of 15' away from Bluebonnet's pole and/or equipment.
  5. #6 solid, bare ground copper wire and clamp attached to Bluebonnet's pole ground.

BUILDING OR RESIDENCE

\* WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. \*

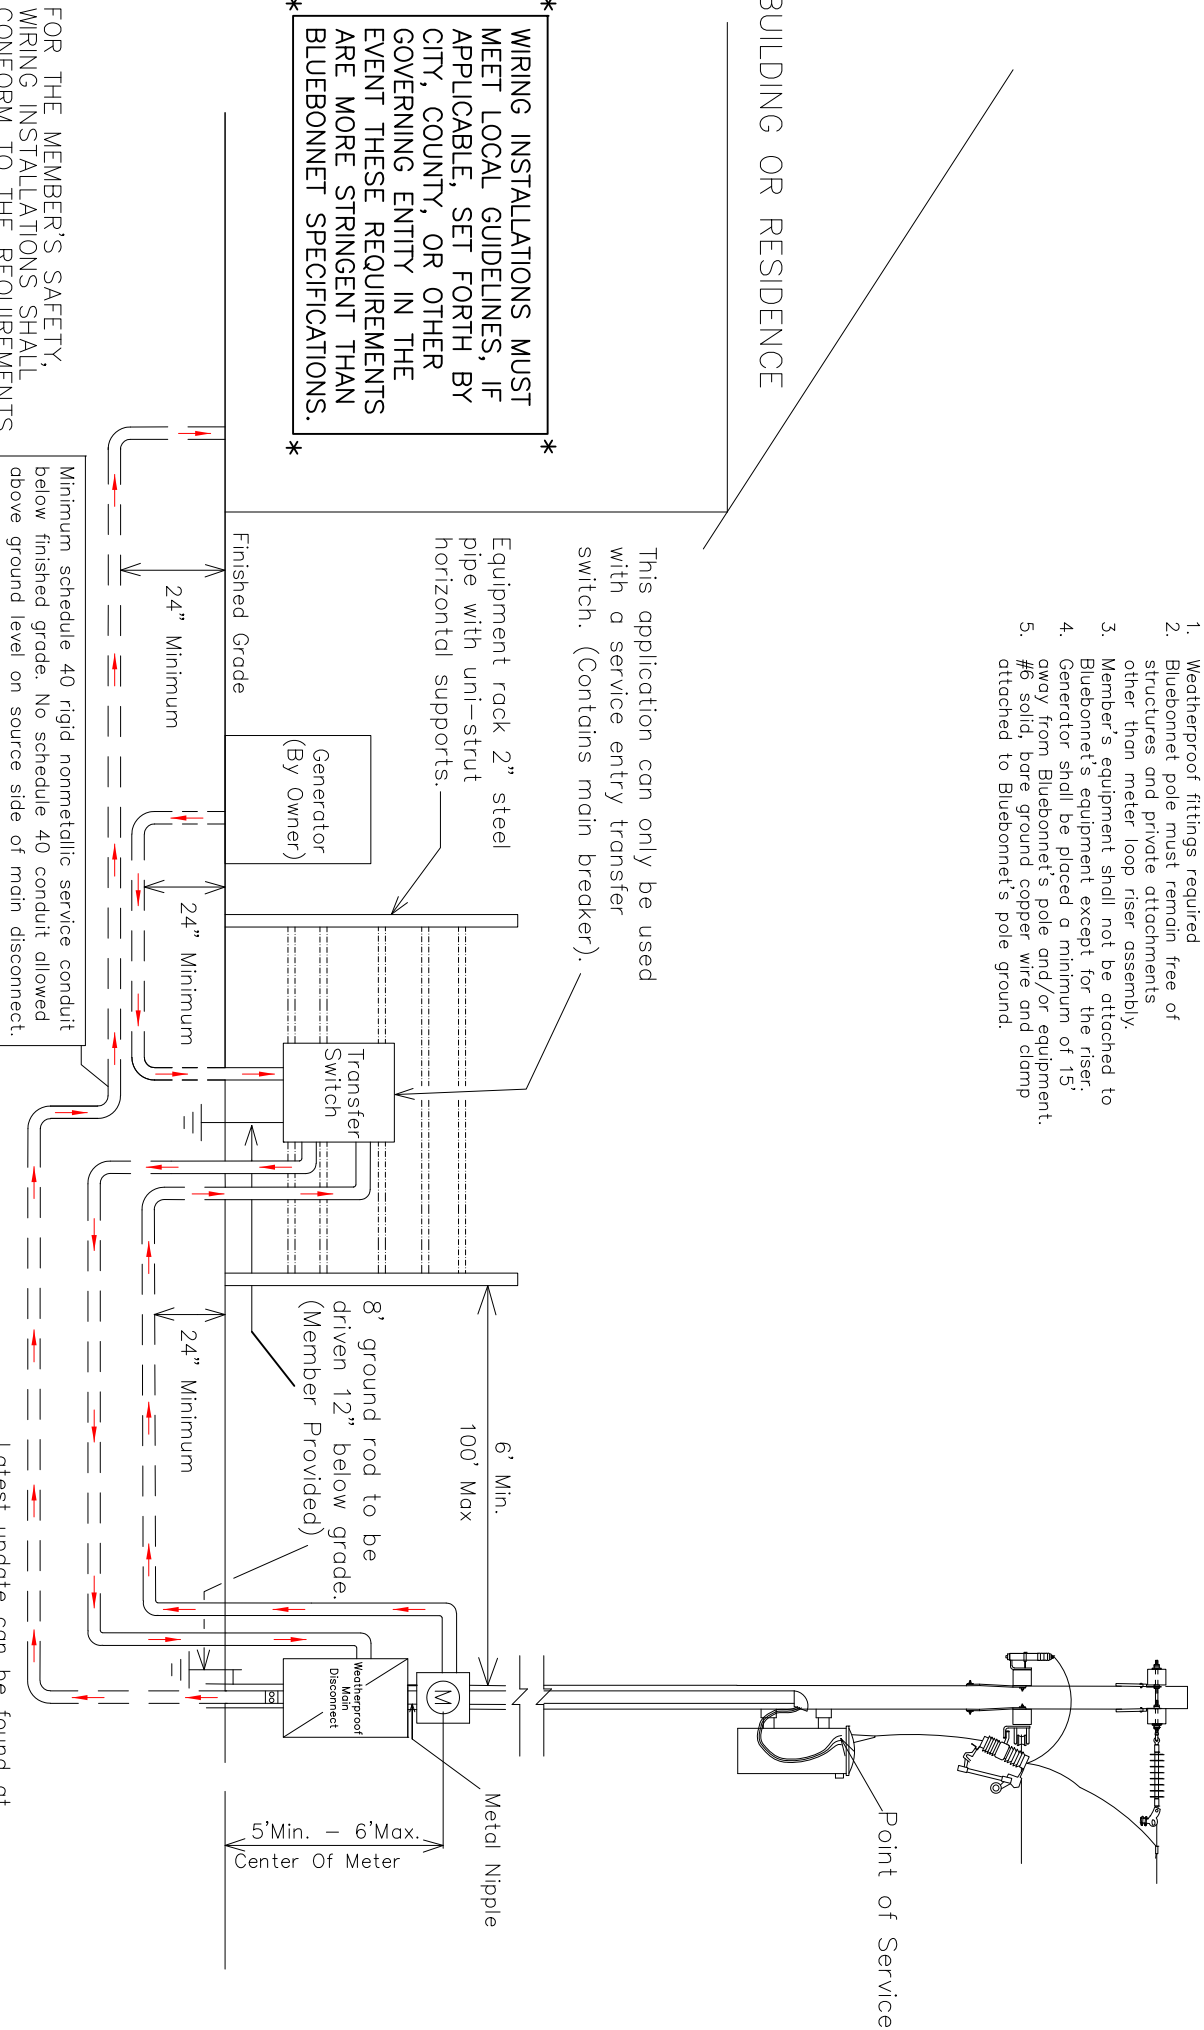

FOR THE MEMBER'S SAFETY, WIRING INSTALLATIONS SHALL CONFORM TO THE REQUIREMENTS OF THE NEC, TDLR AND NESCS.

Latest update can be found at [www.bluebonnetelectric.coop](http://www.bluebonnetelectric.coop)



60-200 AMP 1Ø Existing O/H SERVICE WITH UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON RACK OR BUILDING.		Drawn By :	Checked By :	Approved By :
DATE	REVISIONS	JW	MS COMMITTEE	MS COMMITTEE
03-29-2018	ADDED METAL NIPPLE			
10-30-2018	ADDED GROUND TO RACK			
11-20-2019	ADDED SOLID COPPER NOTE			
		Scale :	Date :	
		NONE	11-04-2021	