


*** WIRING INSTALLATIONS MUST MEET LOCAL GUIDELINES, IF APPLICABLE, SET FORTH BY CITY, COUNTY, OR OTHER GOVERNING ENTITY IN THE EVENT THESE REQUIREMENTS ARE MORE STRINGENT THAN BLUEBONNET SPECIFICATIONS. ***

NOTES:

1. Weatherproof fittings required.
2. Wire sized to total disconnect size.
3. Neutral may only be reduced two sizes on residential application. No reduction of the neutral is allowed on commercial application.
4. Meter assembly must remain unenclosed on exterior of structure.
5. Meter assembly cannot be mounted on a mobile home.
6. Member's equipment shall not be attached to Bluebonnet's equipment except for the riser.
7. #6 solid, bare ground copper wire and clamp attached to Bluebonnet's pole ground.

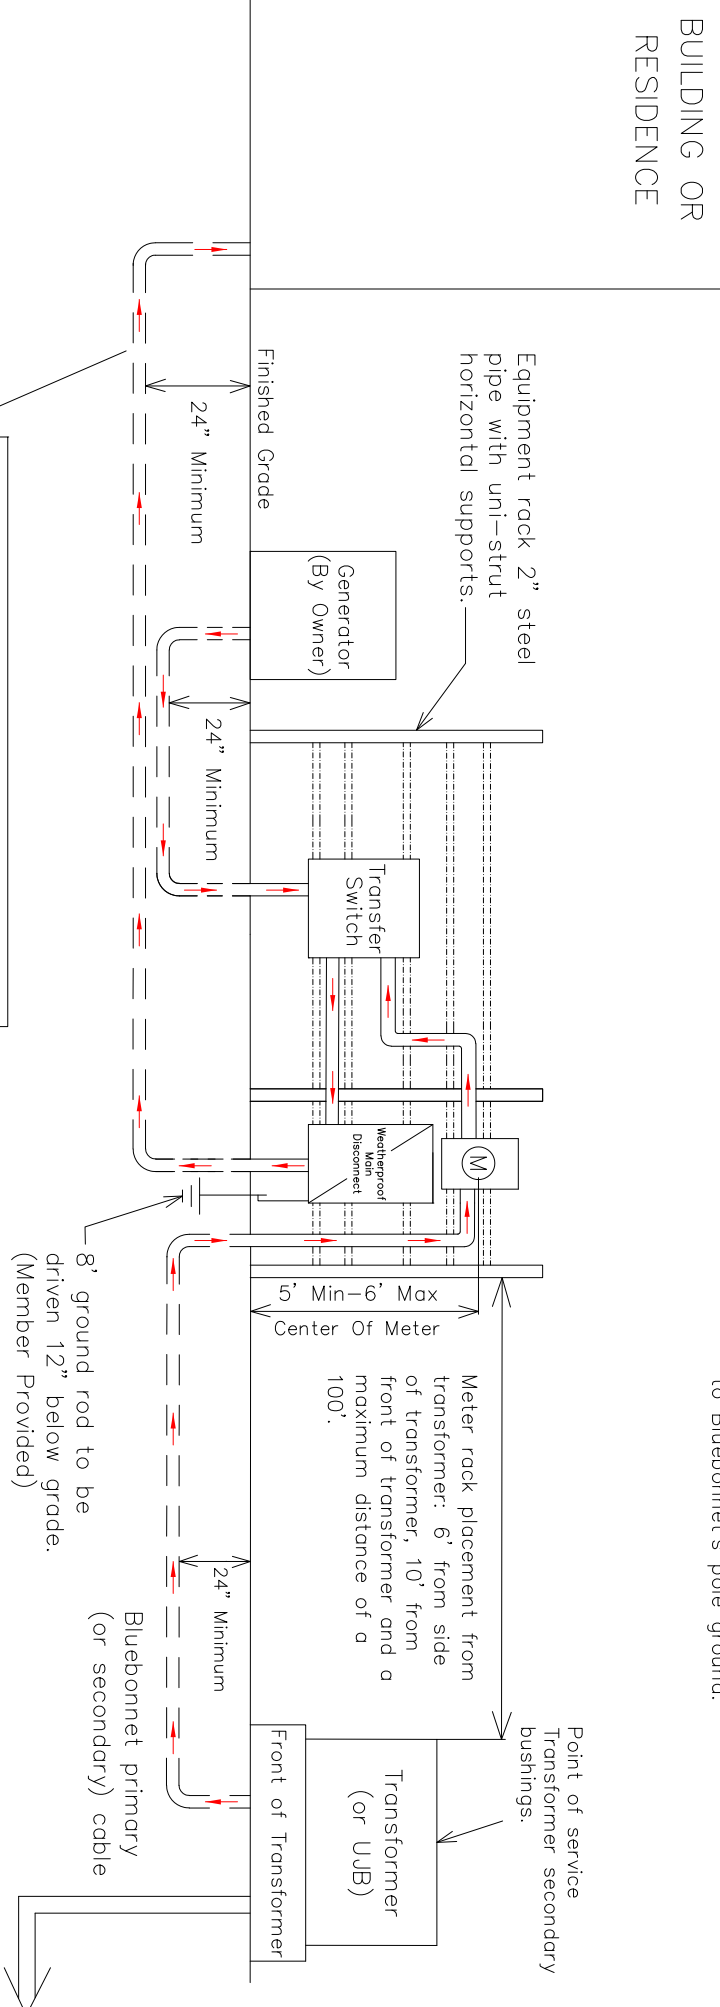

Minimum schedule 40 rigid nonmetallic service conduit below finished grade. No schedule 40 conduit allowed above ground level on source side of main disconnect.

Latest update can be found at www.bluebonnetelectric.coop



60-200 AMP 1Ø Existing URD SERVICE TO A UNDERGROUND STANDBY GENERATOR SYSTEM WITH METER ON RACK OR BUILDING.		Drawn By :	JW	Checked By :	MS COMMITTEE	Approved By :	MS COMMITTEE
DATE	REVISIONS	Scale :	NONE	Date :	11-04-2021		
11-15-2016	ADDED FLOW ARROWS.						
11-20-2019	ADDED SOLID COPPER NOTE.						